

# Northside Pump Station


## Pump Station and Storage Hourly Report

### Max Day Pumped October 26, 2014




Pump Status (0 = OFF; 1 = RUN)						Average Flow (MGD)		
Northside							FLOW01	FLOW02
Hour	Pump 1	Pump 2	Pump 3	Pump 4	Pump 8	Hour	Northside Pump page	Northside Transfer
12:00 AM	0:46:57	1:00:00	0:29:56	1	1			
01:00 AM	0:45:16	0:49:58	0:33:22	0	0	12:00 AM	127.28	124.87
02:00 AM	0:46:20	1:00:00	0:34:22	0	1	01:00 AM	127.01	125.09
03:00 AM	0:47:19	1:00:00	0:27:06	0	1	02:00 AM	127.30	125.68
04:00 AM	0:45:44	0:45:01	0:26:33	1	1	03:00 AM	127.43	125.06
05:00 AM	0:45:46	1:00:00	0:31:21	0	0	04:00 AM	127.32	125.37
06:00 AM	0:46:50	0:54:59	0:27:54	1	0	05:00 AM	127.38	124.94
07:00 AM	0:45:42	0:50:00	0:32:15	0	0	06:00 AM	127.25	125.21
08:00 AM	0:45:38	1:00:00	0:28:01	0	1	07:00 AM	127.29	125.30
09:00 AM	0:46:57	0:55:00	0:32:00	1	1	08:00 AM	127.46	125.14
10:00 AM	0:46:02	1:00:00	0:27:47	0	1	09:00 AM	127.34	125.37
11:00 AM	0:46:35	0:55:00	0:26:10	0	1	10:00 AM	127.38	124.92
12:00 PM	0:46:27	0:49:59	0:31:12	0	1	11:00 AM	127.37	125.32
01:00 PM	0:46:20	0:55:00	0:32:42	0	1	12:00 PM	127.27	124.85
02:00 PM	0:46:07	0:44:59	0:33:42	0	1	01:00 PM	127.23	125.53
03:00 PM	0:45:37	0:49:58	0:30:38	0	1	02:00 PM	127.54	124.54
04:00 PM	0:46:00	0:54:58	0:33:13	0	0	03:00 PM	127.37	124.90
05:00 PM	0:46:39	0:55:00	0:28:07	0	0	04:00 PM	127.41	125.40
06:00 PM	0:45:24	0:45:00	0:31:09	0	0	05:00 PM	127.41	124.74
07:00 PM	0:45:39	0:55:00	0:26:33	0	1	06:00 PM	127.39	124.53
08:00 PM	0:57:50	1:00:00	0:51:15	0	1	07:00 PM	127.53	125.02
09:00 PM	0:46:20	1:00:00	1:00:00	1	1	08:00 PM	127.10	125.43
10:00 PM	0:32:15	1:00:00	0:20:29	1	1	09:00 PM	128.91	124.90
11:00 PM	0:09:50	1:00:00	0:00:00	1	1	10:00 PM	75.79	124.90
						11:00 PM	124.33	124.67

#### Copper Ridge Elevated Storage Tank Level

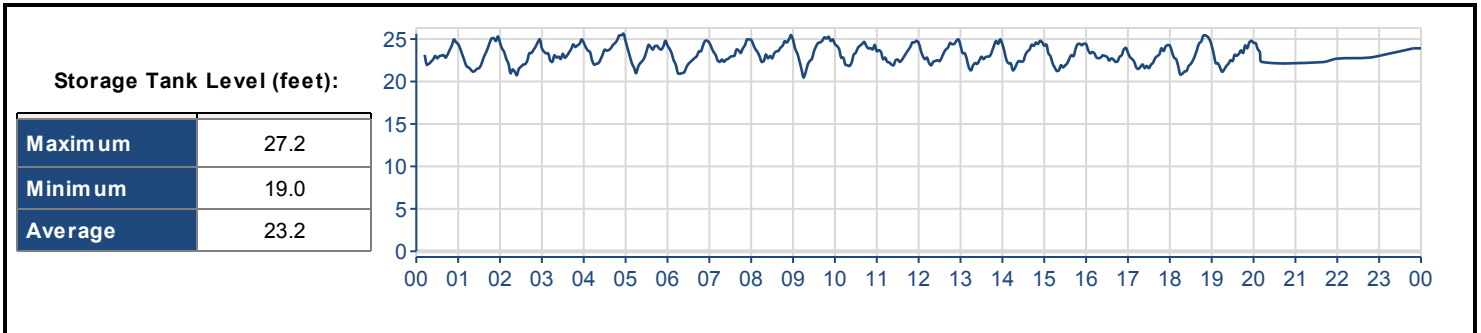

\* Copper Ridge EST is the controlling tower for this pump station

#### Northland 3.0MG Ground Storage Tank Level

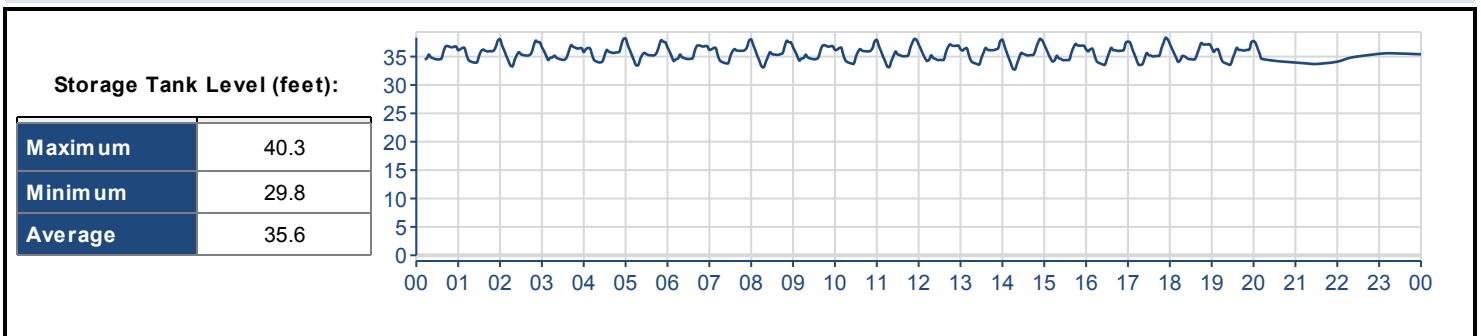

\*\*\* Additional 3.0 MG ground storage tank not represented in data shown \*\*\*